


DATE	SYM	REVISION RECORD	AUTH.	DR.	CK.
	X	DESCRIPTION	XX	gjp	

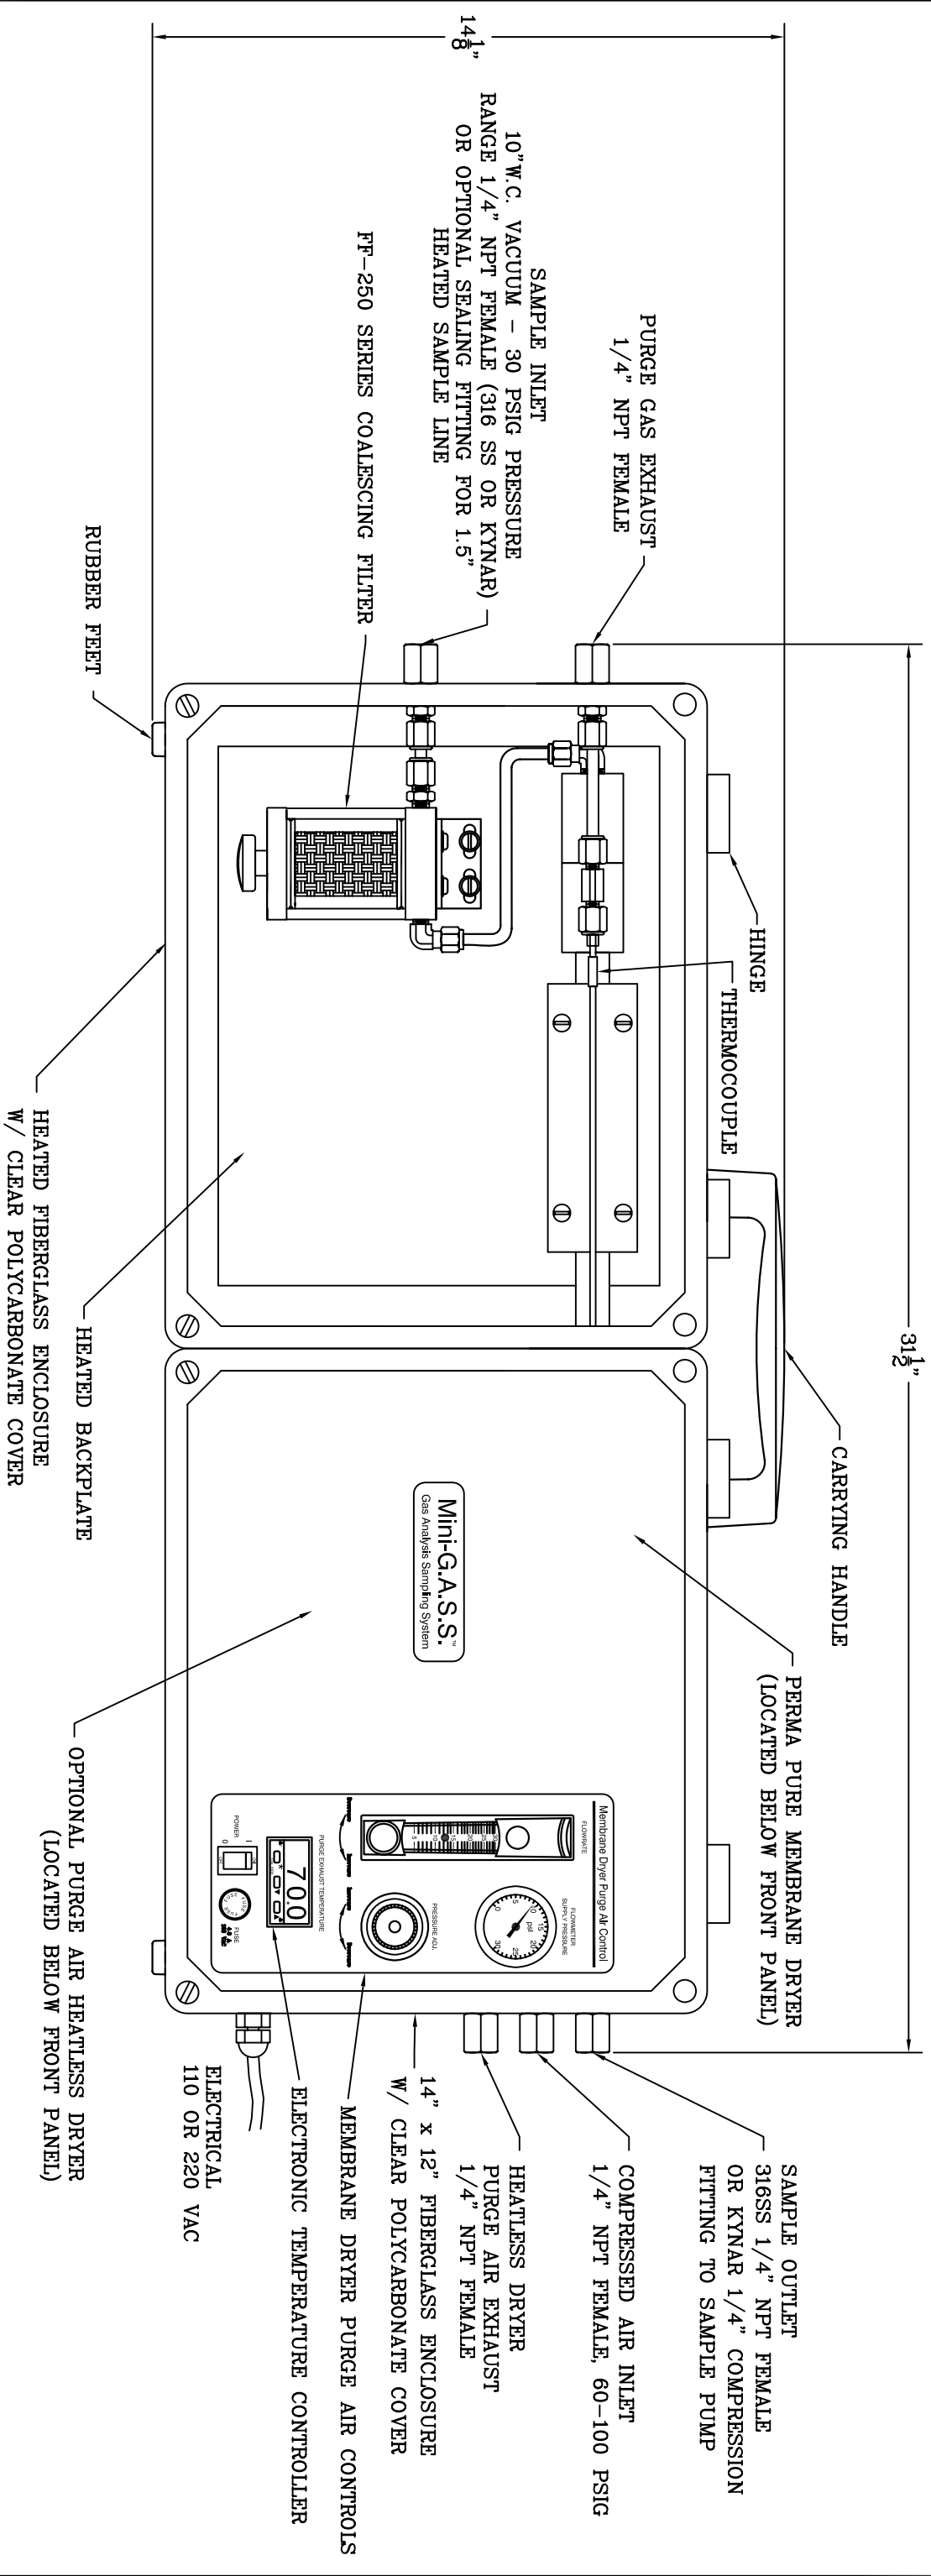

NOTES:
ENCLOSURE DEPTH - 8"
PURGE AIR REQUIREMENTS:
- WITH HEATLESS DRYER
60-100 PSIG NON CONDENSING
- WITHOUT HEATLESS DRYER
30-100 PSIG, -40° DEW POINT
ELECTRICAL REQUIREMENT :
110/220 VAC, 60 HZ, 485 WATTS

TOLERANCES (EXCEPT AS NOTED)		PERMA PURE INCORPORATED 8 EXECUTIVE DRIVE, TOMS RIVER N.J. 08754	
DECIMAL	± .005"	REFERENCE	SCALE
FRACTIONAL	± 1/84"	DRAWN BY	DATE
ANGULAR	± 1/2°	APPROVED BY	DATE
JOB REF.		TITLE	
		TRANSPORTABLE MINI-GASS SYSTEM	
DATE	10/8/01	SIZE	DRAWING NUMBER
		B	MG-2812-01-02
			REV.
			-